

PUBLIC HEALTH ENGINEERING DEPARTMENT

DISTRICT WATER TESTING LABORATORY, BHIWANI

Website :- <https://phedharyana.gov.in/>

Memo No:- 1325

Date:- 28/09/2026

Subject : Physical / Chemical Examination Report of Water Sample

Sample ID/Classification : BHW/04491/9/2026 / Private	Sample Details	Date & Time
Sender : GLOBAL SR SEC SCHOOL	Collected By	SANJAY KUAMR
Location : , MIRAN	Collection Date	25/09/2026 at 10:30
Sample Description : Drinking Water	Received at lab	25/09/2026 at 15:33
Latitude / Longitude : 75.736356 / 28.845463	Analysis Start Date	28/09/2026
	Analysis End Date	28/09/2026
	Sample Quantity	2 Ltr.

Test Result (As Per BIS 10500 :2012)

S.No.	Tested Parameter	Result	Requirement (Acceptable Limit)	Permissible Lmt. (In the Absence of Alternate Source)	Protocol Used
1	Turbidity	0.34	1 NTU	5 NTU	APHA 24th Edition -2130 B
2	Taste	Agreeable	Agreeable	Agreeable	APHA 24th Edition -2160C
3	Odour	Agreeable	Agreeable	Agreeable	APHA 24th Edition -2150B
4	Color	5	5 Hazen Units	15 Hazen Units	APHA 24th Edition -2120B
5	Total Dissolved Solids @ 180°C ± 2°C	192	500 mg/lit.	2000 mg/lit.	APHA 24th Edition -2540 C
6	Total Hardness as CaCO ₃	160	200 mg/lit.	600 mg/lit.	APHA 24th Edition -2340 C
7	Calcium (as Ca)	36.07	75 mg/lit.	200 mg/lit.	APHA 24th Edition-3500-Ca B
8	Magnesium (as Mg)	17.01	30 mg/lit.	100 mg/lit.	APHA 24th Edition -3500 Mg B
9	Total Alkalinity	90	200 mg/lit.	600 mg/lit.	APHA 24th Edition -2320 B
10	Chloride (as Cl)	38.99	250 mg/lit.	1000 mg/lit.	APHA 24th Edition -4500 Cl-B
11	Sulphate as SO ₄	37	200 mg/lit.	400 mg/lit.	USEPA / APHA 24th -4500 SO ₄ -E
12	Fluoride (as F)	0.21	1.0 mg/lit.	1.5 mg/lit.	APHA 24th Edition-4500F C/
13	Iron (as Fe)	0.02	1.0 mg/lit.	1.0 mg/lit.	USEPA
14	Nitrate (as NO ₃)	0.41	45 mg/lit.	45 mg/lit.	APHA 24th Edition -4500 NO ₃ D
15	pH @ 25°C	8.03	6.5 - 8.5	6.5 - 8.5	APHA 24th Edition 4500-H+ B

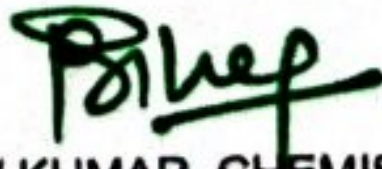
Remarks :-

- * The Results Given above are related to the sample as received and tested in PHED BHIWANI Lab.
- * The test report can't be regenerated in whole or part there of without written permission of Competent Authority.
- * The test report can't be used for any publicity or any legal purpose.
- * Reliability of water sample sample lies with sender/collector of water sample.
- * To check the sample report online Scan the QR Code below.
- * The test samples meant for chemical analysis will be disposed off after 7 days from the date of issue of test report unless until specifically requested by the customer for retaining over a longer period.

Water Sample has been found "CONFORMING" to Limits set in BIS10500:2012 for the tested parameters.



Sample analyzed by :


RAJEEV KUMAR, CHEMIST
DISTRICT WATER TESTING LABORATORY BHIWANI
email:-chemist.bhiwani@phedharyana.gov.in